

CONTACTOR COMBINATION, STAR-DELTA
(PREASSEMBLED) SIDE-MOUNTING ON TIME
RELAY, AC-3 22/30KW/400 V, 3-POLE, SIZE
S2,S2,S0,EL. LOCK. DEVICE, SCREW CONNECTION,
AC 110V, 50/60HZ



Figure similar

General technical data:		
product brand name		SIRIUS
Product designation		contactor assembly
Product function		wye-delta-contactor
Size of contactor		S2, S2, S0
Protection class IP on the front		IP20
Degree of pollution		3
Insulation voltage with degree of pollution 3 rated value	V	690
Installation altitude at height above sea level maximum	m	2 000
Ambient temperature		
• during operation	°C	-25 ... +60
• during storage	°C	-55 ... +80
• during transport	°C	-55 ... +80
Equipment marking acc. to DIN 40719 extended according to IEC 204-2 acc. to IEC 750		K
Equipment marking acc. to DIN EN 61346-2		Q

Mechanical service life (switching cycles)		
• of the main contacts typical		10 000 000
• of auxiliary contacts typical		10 000 000
• of the contactor with added auxiliary switch block typical		10 000 000
Main circuit:		
Number of poles for main current circuit		3
Number of NC contacts for main contacts		0
Operating voltage at AC-3 rated value maximum	V	690
Operating current at AC-3 at 400 V rated value	A	65
Operating power at AC-3		
• at 400 V rated value	kW	30
• at 500 V rated value	kW	35
• at 690 V rated value	kW	34
Control circuit/ Control:		
Control version of the switch operating mechanism		conventional
Design of the surge suppressor		without
Type of voltage of the control supply voltage		AC
Control supply voltage frequency		
• 1 rated value	Hz	50
• 2 rated value	Hz	60
Control supply voltage 1		
• at AC		
— at 50 Hz rated value	V	110
— at 60 Hz rated value	V	110
Operating range factor control supply voltage rated value of magnet coil		
• at AC		
— at 50 Hz		0.8 ... 1.1
— at 60 Hz		0.85 ... 1.1
• at DC		0.8 ... 1.1
Auxiliary circuit:		
Product extension Auxiliary switch		Yes
Number of NC contacts for auxiliary contacts		
• instantaneous contact		4
• lagging switching		0
Number of NO contacts for auxiliary contacts		
• instantaneous contact		4
• leading contact		0
Short-circuit:		
Design of the fuse link		

- for short-circuit protection of the auxiliary switch required
- for short-circuit protection of the main circuit
 - with type of coordination 1 required
 - with type of assignment 2 required

fuse gL/gG: 10 A

fuse gL/gG: 125 A

fuse gL/gG: 63 A

Installation/ mounting/ dimensions:

Mounting position		with vertical mounting surface +/-180° rotatable, with vertical mounting surface +/- 30° tiltable to the front and back
Mounting type		screw fixing
Width	mm	178
Height	mm	140
Depth	mm	169
Required spacing		
• with side-by-side mounting at the side	mm	0
• for grounded parts at the side	mm	0
• for live parts		
— at the side	mm	0

Connections/ Terminals:

Type of electrical connection for main current circuit	screw-type terminals
---	----------------------

Certificates/ approvals:

Certificate of suitability	CE / UL / CCC / GL / LRS / BV / DNV / RMRS / RINA / PRS / ABS
-----------------------------------	---

General Product Approval	Declaration of Conformity	Shipping Approval
---------------------------------	----------------------------------	--------------------------



other

[Umweltbestätigung](#)

[Bestätigungen](#)

Safety related data:

Contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
--	---

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrymall>

Cax online generator


<http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RA1434-8XC21-1AG2>


Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/en/ps/3RA1434-8XC21-1AG2>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)

http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RA1434-8XC21-1AG2&lang=en

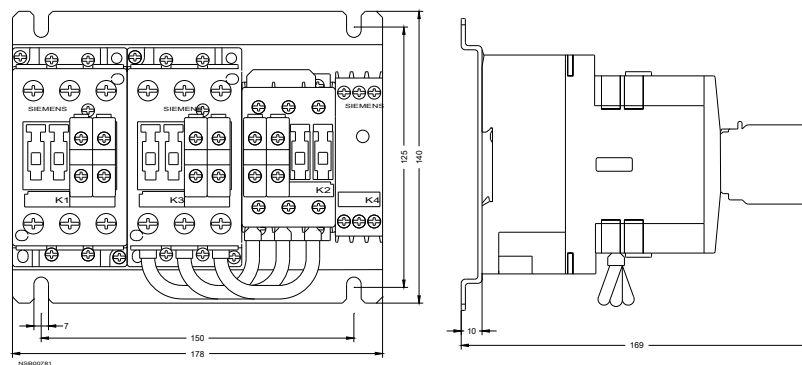

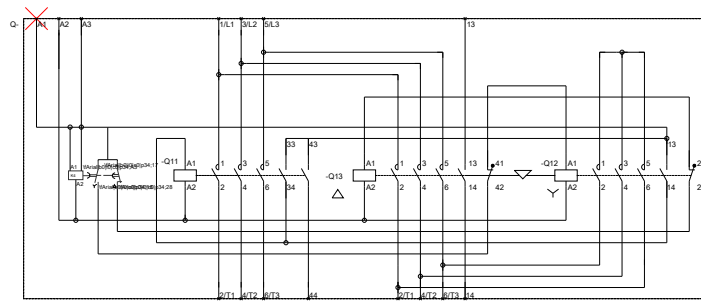

×

last modified:

10/07/2016