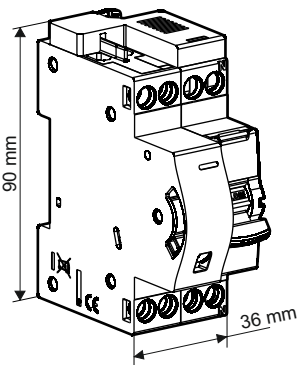
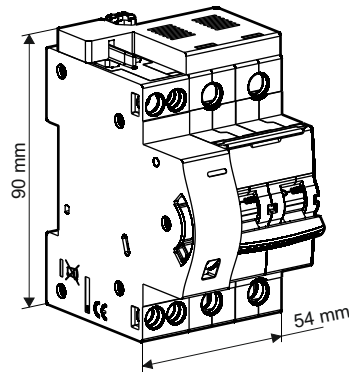


4 159 20/21/22/29/30/31/32



EN 62606
IEC/EN 60898-1
230V~ 50Hz
Curve B & C
IP 20
AUTOTEST 24h

**4 159 38**



EN 62606
IEC/EN 60898-1
230V~ 50Hz
Curve C
IP 20
AUTOTEST 24h

**4 159 56/57/58/65/66/67/68**


EN 62606
IEC/EN 61009-1
230V~ 50Hz
I Δ n 30mA Type A
Curve B & C
IP 20
AUTOTEST 24h

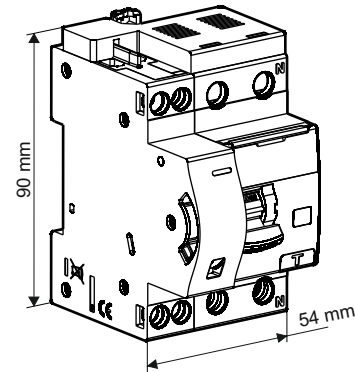





-A coller près de l'appareil
-This notice should be affixed near the device
-Das Haftschild in Gerätenähe anbringen
-Nakleićw pobliżu wyłącznika

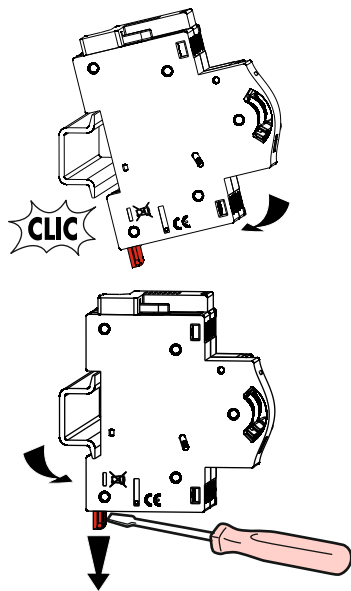

LOAD (OUT)

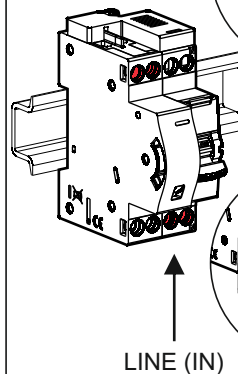

LINE (IN)



Test diélectrique
Insulation test
Isolationsprüfung
Test izolacji

