

ONLITE central EPD 2

Detektor faz

Nr art. 24161074

Zastosowanie


The three-phase monitoring module monitors three-phase mains supplies for undervoltage and phase failure (each phase with respect to the neutral conductor).

Wskazówki dotyczące planowania

In standard use, a three-phase mains supply plus neutral line is required at the inputs to the ONLITE central EPD 2, and must be connected to the terminals L1/L2/L3 and N. If only one phase is monitored, the remaining inputs (L2/L3) must be linked to the phase being monitored; a neutral line is always required.



Schemat połączeń

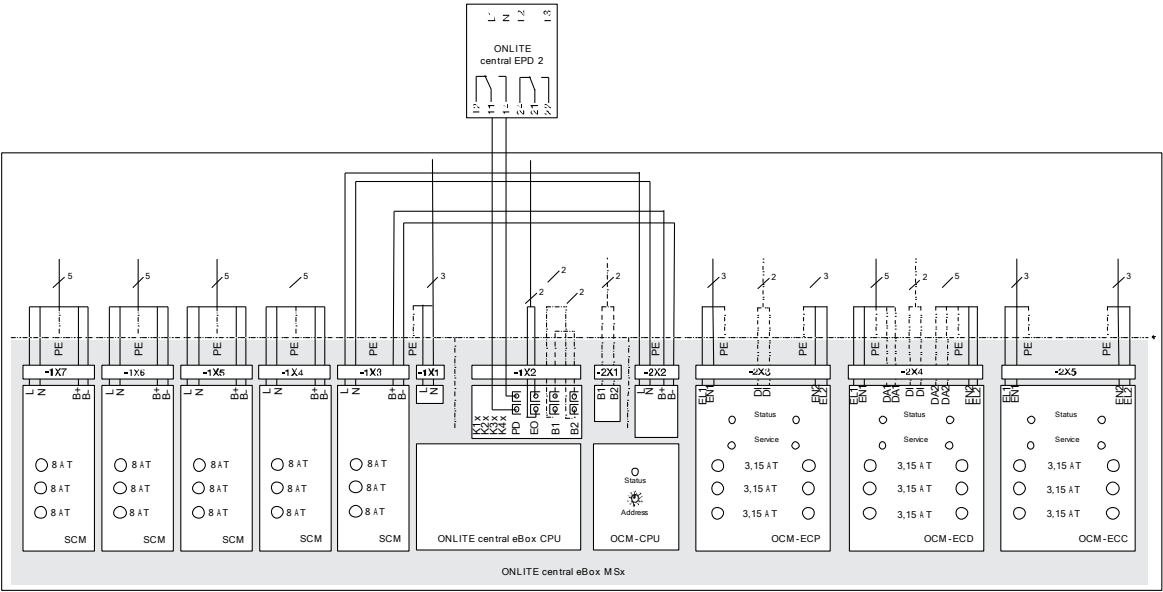

Rozmiar

